
Alarm Code 23	Abnormality of Thermistor for Compressor Discharge Gas Temperature(Td)


- Alarm code is displayed on the master controller/ the 7-segment of O.U. display PCB / the 7-segment of I.U. PCB1.

★ This alarm code is indicated when a short circuit (less than 0.9kΩ) for a second or disconnection (more than 5946kΩ) of the thermistor is detected during the operation.


O.U. main PCB: Outdoor Unit main PCB

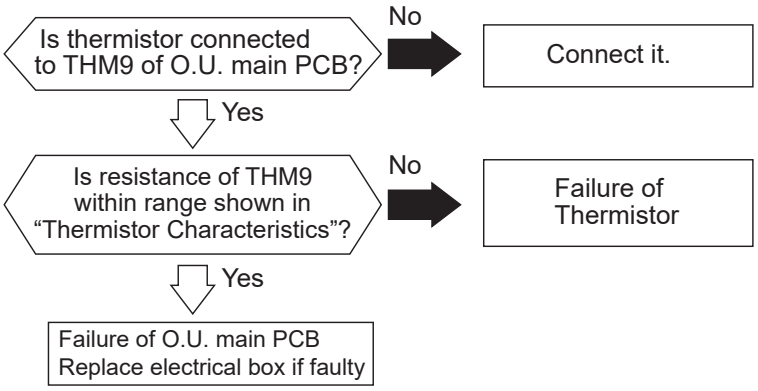

044-080: Thermistor Characteristics (Td)

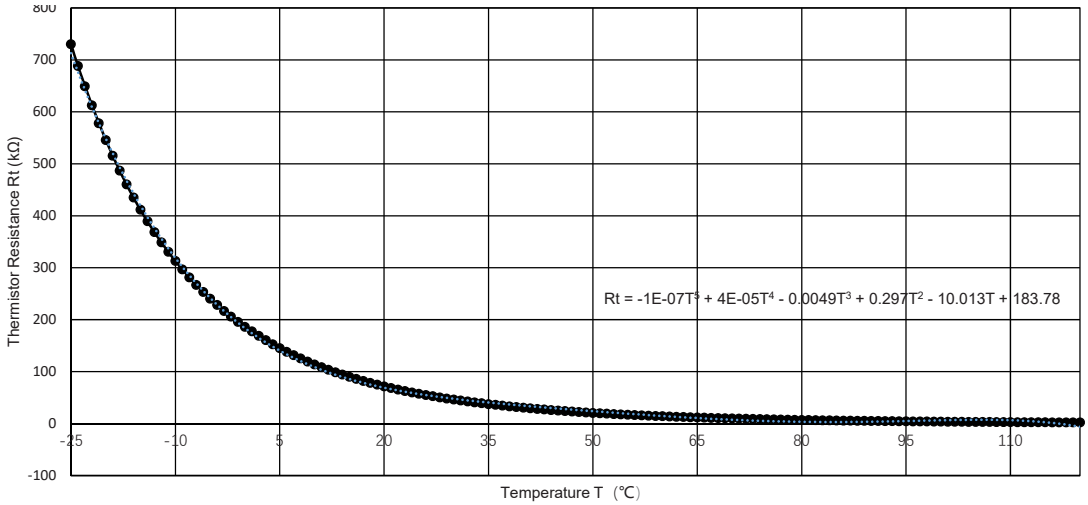

100-160: Thermistor Characteristics (Td)

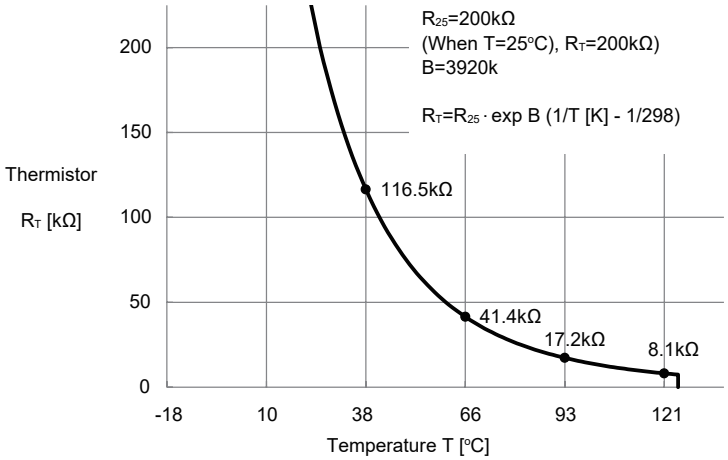

Phenomenon	Cause	Check Item	Action(Turn OFF Main Switch)
Faulty Compressor Discharge Gas Thermistor(Td)	Fault	Check resistance.	Replace thermistor if faulty.
	Incorrect Connection	Check wiring to O.U. main PCB.	Repair wiring and connections.
Faulty O.U. main PCB			Replace O.U. main PCB if faulty.